

LUMINAIRE SCHEDULE

Symbol	Label	Qty	Catalog Number	Description	Lamp	File	Lumens	LLF	Watts
C		25	DMW 2 54T5HO	4FT WET LOCATION ENCLOSURE WITH (2) T5HO LAMPS, 50% DR HIGH IMPACT ACRYLIC LENS	TWO 54-WATT LINEAR FLUORESCENT T5HO	DMW_2_54T5HO.ies	4400	0.85	110.3

STATISTICS


Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
area summary@floor	+	5.7 fc	18.5 fc	1.0 fc	18.5:1	5.7:1

NOTES

1. Readings shown are in units of maintained footcandles.
2. Total light loss factor = See luminaire schedule
3. Test plane = 0' aff
4. Ceiling height = 10' aff
5. Fixture mounting height = 8.5' aff
6. Fixture spacing = See plan view
7. Reflectance = 10/10/10
8. This photometrics layout was calculated using specific criteria, any deviation from stated parameters will effect actual performance.
9. These lighting calculations are not a substitute for independent engineering analysis of lighting system suitability and safety.

POWER DENSITY STATISTICS

Name	# Luminaires	Total Watts	Area	Density
Power Density Zone # 1	25	2757.50 W	21736.24 ft ²	0.13 W/ft ²

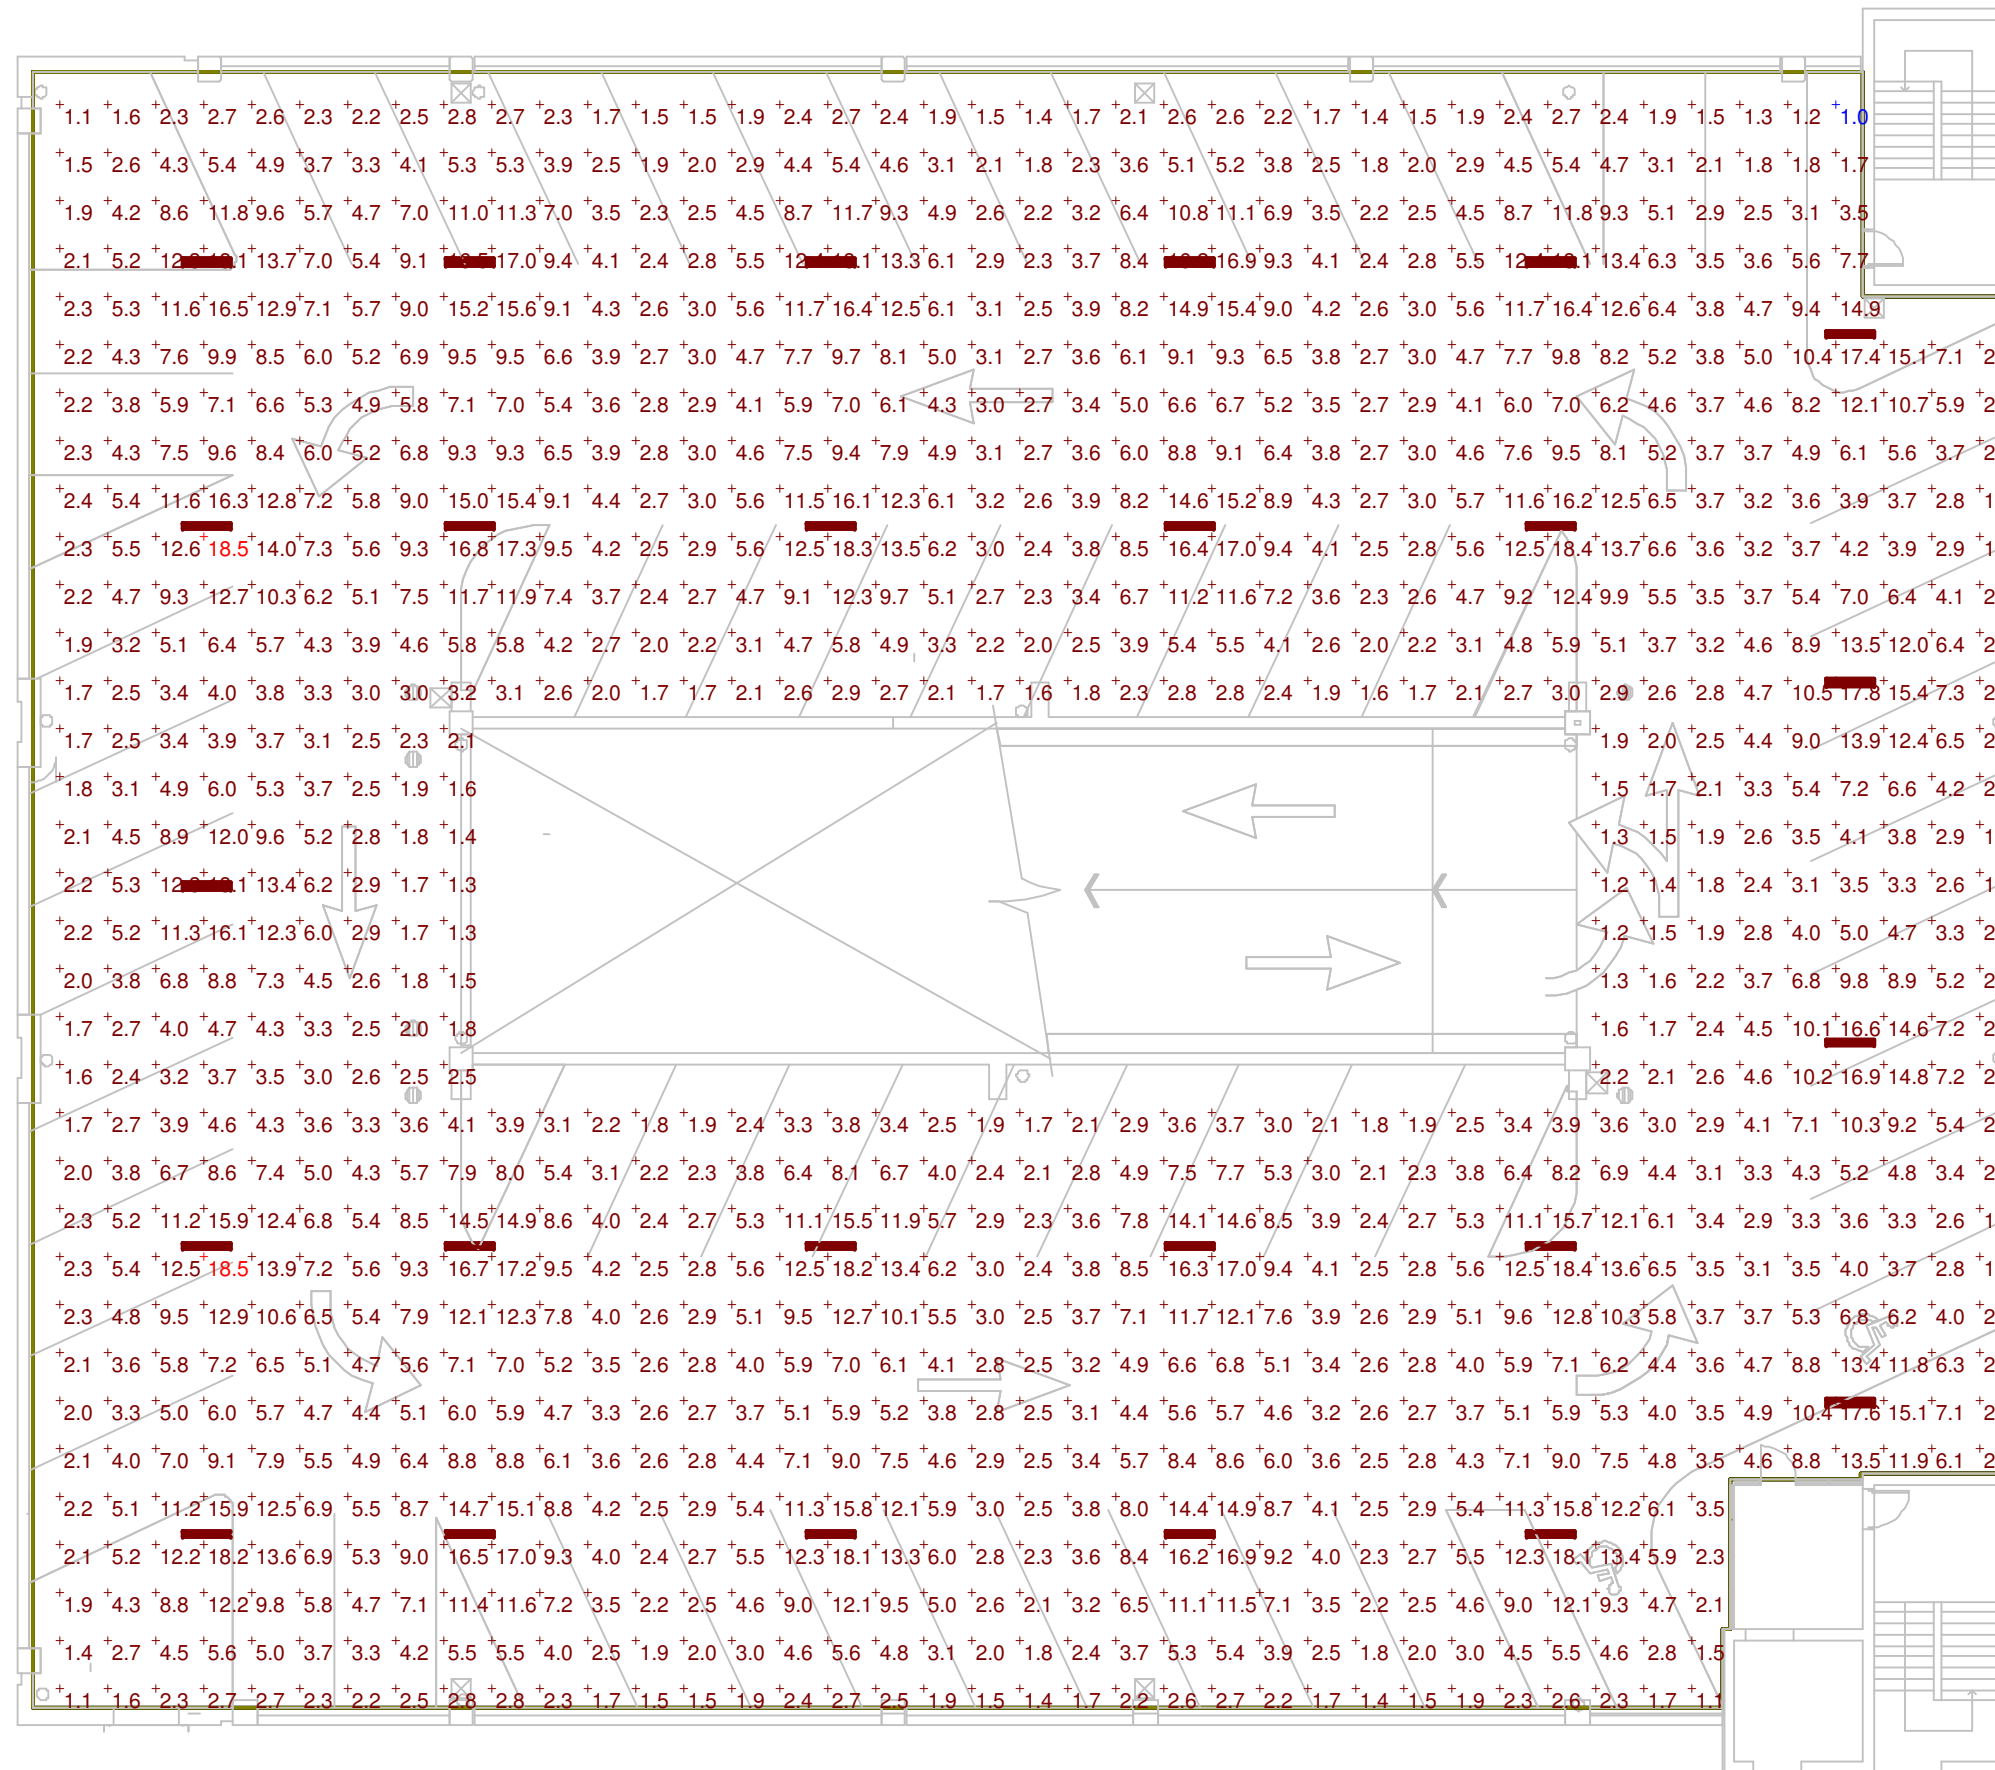

Plan View
Scale 1" = 16'