


IECC 2015 DESIGN GUIDE

PRIVATE OFFICE ≤ 300sqft WITH 0-10V DIMMING FIXTURES



SENSOR SWITCH

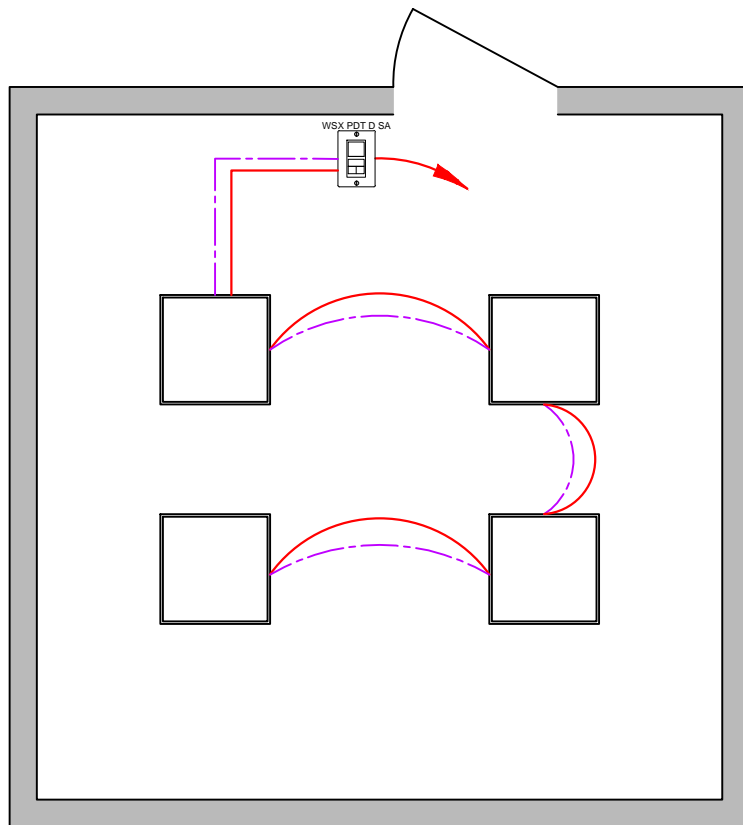

SEQUENCE OF OPERATION:

LIGHTS

- ALL LIGHTS ARE DIMMABLE
- ALL FIXTURES ARE CONTROLLED TOGETHER

OCCUPANCY

- LIGHTS MUST BE TURNED ON MANUALLY (OR OPTIONALLY CAN BE CONFIGURED TO COME ON AUTOMATICALLY TO 50%)
- LIGHTS AUTOMATICALLY TURN OFF WHEN ROOM BECOMES VACANT

DAYLIGHT

- NOT REQUIRED FOR OFFICES WITHOUT WINDOWS OR THAT HAVE LOADS <150W


MANUAL

- ON/OFF & RAISE/LOWER CONTROL OF LIGHTS

ADDITIONAL OPTIONS:

- SURFACE OR RECESSED MOUNT SENSORS ALSO AVAILABLE
- FOR EMERGENCY LIGHTING CONTROL ADD A PP16 SHUNT PACK.

DIAGRAM LEGEND



BILL OF MATERIAL

QTY	PRODUCT #	DESCRIPTION
1	WSX PDT D SA	MANUAL ON AUTO OFF & RAISE/LOWER DUAL TECHNOLOGY WALL OCCUPANCY SWITCH

SUPPORTS THE FOLLOWING REQUIREMENTS:

- ✓ FULL AUTO-OFF VIA OCCUPANCY SENSOR (C405.2.1.1)
- ✓ LOCAL SWITCH (C405.2.2.3)
- ✓ LIGHTING REDUCTION (C405.2.2.2)