


CA TITLE 24 2019 DESIGN GUIDE

WIRELESS CORRIDOR WITH nLIGHT AIR ENABLED FIXTURES



nLIGHT AIR

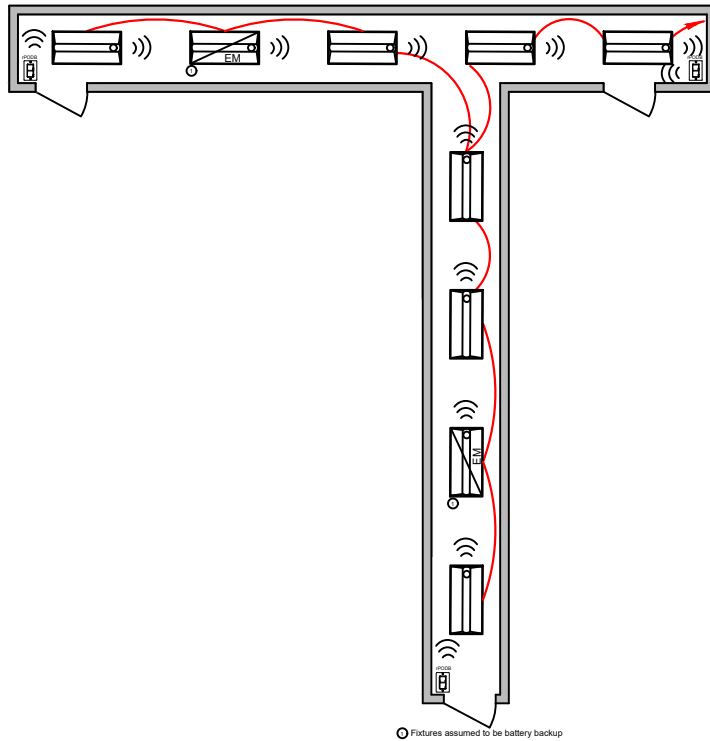

① NOTE: FIXTURE ASSUMED TO BE BATTERY BACKUP

SEQUENCE OF OPERATION:

LIGHTS

- ALL LIGHTS ARE DIMMABLE
- ALL FIXTURES CONTROLLED TOGETHER OR INDEPENDENTLY
- MAXIMUM LEVEL CAN BE TASK TUNED TO ANY PERCENTAGE VIA PROGRAMMING

OCCUPANCY

- FIXTURES AUTOMATICALLY TURN OFF OR OPTIONALLY CAN BE CONFIGURED TO DROP TO LOW DIM SETTING OF AT LEAST 50% WHEN SPACE BECOMES VACANT

DAYLIGHT

- NOT REQUIRED IF ROOM HAS <24 FT2. OF GLAZING OR LIGHTING LOAD < 120W IN THE SKYLIT AND THE SIDELIT DAYLIT ZONE
- SMOOTH CONTINUOUS DIMMING
- CUSTOM GROUPING OF FIXTURES INTO SEPARATE DAYLIGHT ZONES (MAX. NUMBER OF ZONES = NUMBER OF FIXTURES)


MANUAL

- MASTER ON/OFF & RAISE /LOWER CONTROL OF ENTIRE SPACE

ADDITIONAL OPTIONS:

- SURFACE OR RECESSED MOUNT SENSORS ALSO AVAILABLE
- SPACE / ZONE CAN BE CONNECTED TO nLIGHT BACKBONE TO ENABLE NET-WORK CONTROL OR ADR (AUTOMATIC DEMAND RESPONSE)
- CONTROL HVAC SYSTEMS via AN OPTIONAL RELAY "AR" OR THROUGH THE BACNET ECLYPSE CONTROLLER.

DIAGRAM LEGEND



BILL OF MATERIAL

QTY	PRODUCT #	DESCRIPTION
7	SEE NOTE	nLIGHT AIR ENABLED FIXTURE
2	SEE NOTE	nLIGHT AIR ENABLED FIXTURE w/ BATTERY OPTION
3	rPODB DX G2	ON/OFF & RAISE/LOWER WALL POD

SUPPORTS THE FOLLOWING REQUIREMENTS:

✓ FULL/ PARTIAL AUTO-OFF VIA OCCUPANCY SENSOR (SECTION 130.1c)

✓ AREA CONTROL (SECTION 130.1a)

✓ AUTOMATIC OFF via PROGRAMMABLE TIME CLOCK (SECTION 130.1c)

✓ AUTOMATIC DEMAND RESPONSE (ADR) READY (SECTION 130.1e)

Note: Contact your local lighting agent for more information on nLight enabled fixtures