


CA TITLE 24 2019 DESIGN GUIDE

WIRELESS PRIVATE RESTROOM WITH nLIGHT AIR ENABLED FIXTURES

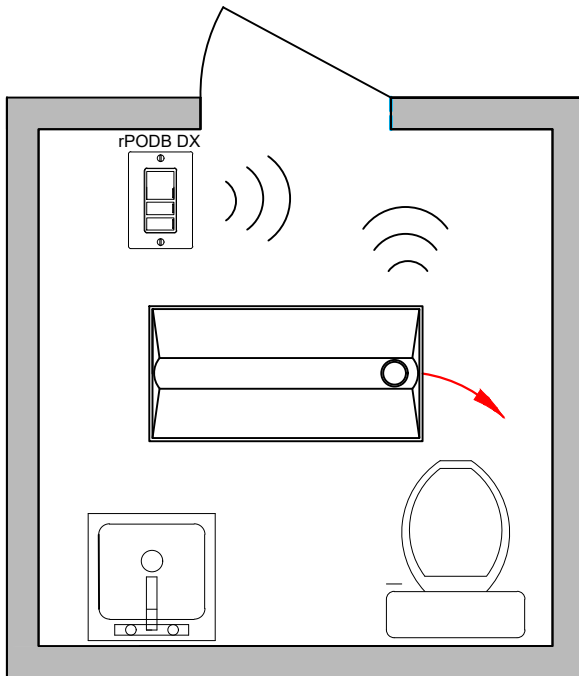

SEQUENCE OF OPERATION:

LIGHTS

- ALL LIGHTS ARE DIMMABLE
- FIXTURES ARE CONTROLLED BASED ON POWER PACK LINE VOLTAGE AND 0-10V WIRING
- MAXIMUM LEVEL CAN BE TASK TUNED TO ANY PERCENTAGE VIA PROGRAMMING

OCCUPANCY

- PARTIAL-ON OCCUPANCY SENSORS AUTOMATICALLY ACTIVATE BETWEEN 50-70% OF CONTROLLED LIGHTING POWER OR FIXTURES MUST BE TURNED ON MANUALLY

DAYLIGHT

- NOT REQUIRED IF ROOM HAS <24 FT². OF GLAZING OR LIGHTING LOAD < 120W IN THE SKYLIT AND THE SIDELIT DAYLIT ZONE
- SMOOTH CONTINUOUS DIMMING
- DAYLIGHT ZONES DEFINED BY RELAY PACKS

MANUAL

- ON/OFF & RAISE/LOWER CONTROL OF FIXTURES

ADDITIONAL OPTIONS:

- ROOM CAN BE CONNECTED TO nLIGHT BACKBONE TO ENABLE NETWORK CONTROL, TIME SCHEDULES AND AUTOMATED DEMAND RESPONSE (OPENADR 2.0A)
- HVAC CONTROL AVAILABLE THROUGH SYSTEM-WIDE BACNET® INTERFACE OPTION ON THE ECLYPSE® CONTROLLER
- WIRELESS FIXTURE EMBEDDED CONTROL AND OCCUPANCY/DAYLIGHTING SENSOR OPTIONS AVAILABLE, PLEASE SEE THE FIXTURE SPECIFICATION SHEET

DIAGRAM LEGEND	
	LINE VOLTAGE WIRES
	LINE POWER

BILL OF MATERIAL		
QTY	PRODUCT #	DESCRIPTION
1	SEE NOTE	nLIGHT AIR ENABLED FIXTURE
1	rPODB DX G2	ON/OFF, RAISE / LOWER WALL POD

SUPPORTS THE FOLLOWING REQUIREMENTS:

✓ FULL AUTO-OFF VIA OCCUPANCY SENSOR (SECTION 130.1c)

✓ AREA CONTROL (SECTION 130.1a)

✓ AUTOMATIC DEMAND RESPONSE (ADR) READY (SECTION 130.1e)

Note: Contact your local lighting agent for more information on nLight enabled fixtures