

**SEQUENCE OF OPERATION:**

**LIGHTS**

- ALL LIGHTS ARE DIMMABLE
- ALL FIXTURES CONTROLLED TOGETHER
- ADJUSTABLE HIGH/LOW TRIM

**OCCUPANCY**

- LIGHTS AUTOMATICALLY GO TO FULL BRIGHT WHEN OCCUPIED
- LIGHTS AUTOMATICALLY TURN OFF OR DROP TO OPTIONAL LOW DIM SETTING WHEN SPACE BECOMES VACANT

**ADDITIONAL OPTIONS:**

- SURFACE OR RECESSED MOUNT SENSORS ALSO AVAILABLE
- SPACE / ZONE CAN BE CONNECTED TO nLIGHT BACKBONE TO ENABLE NETWORK CONTROL OR TIME SCHEDULES (C405.2.2.1)
- HVAC CONTROL AVAILABLE THROUGH SYSTEM-WIDE BACNET® INTERFACE OPTION ON THE ECLYPSE CONTROLLER

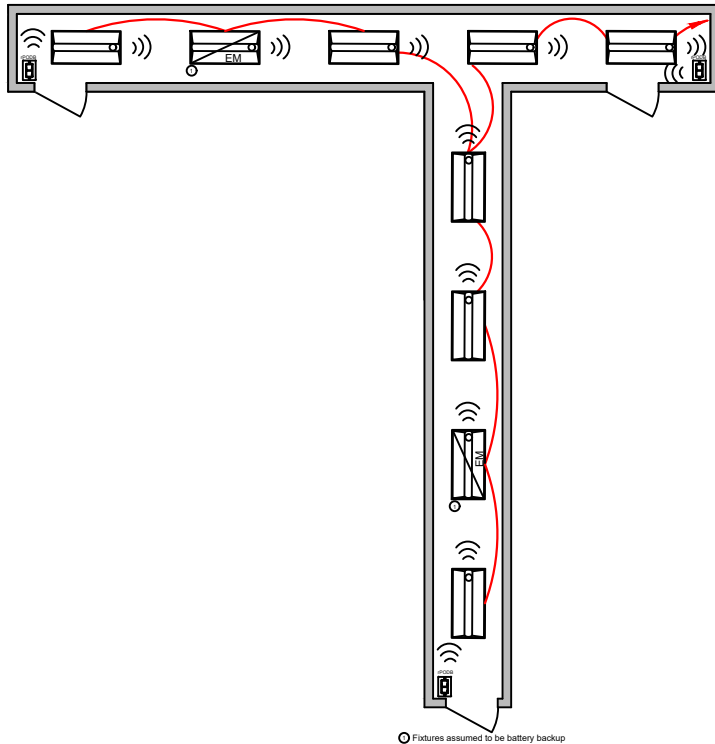







DIAGRAM LEGEND	
	LINE VOLTAGE WIRES
	LINE POWER

BILL OF MATERIAL		
QTY	PRODUCT #	DESCRIPTION
7	SEE NOTE	nLIGHT WIRELESS ENABLED FIXTURE
2	SEE NOTE	nLIGHT WIRELESS ENABLED FIXTURE with BATTERY OPTION
3	rPODB G2	ON/OFF WALL POD

**SUPPORTS THE FOLLOWING REQUIREMENTS:**

-  FULL AUTO-OFF VIA OCCUPANCY SENSOR (C405.2.1.1)
-  LOCAL SWITCH (C405.2.2.3)
-  ENHANCED DIGITAL LIGHTING CONTROLS (C406.4)

**Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the WSEC CODE.**