

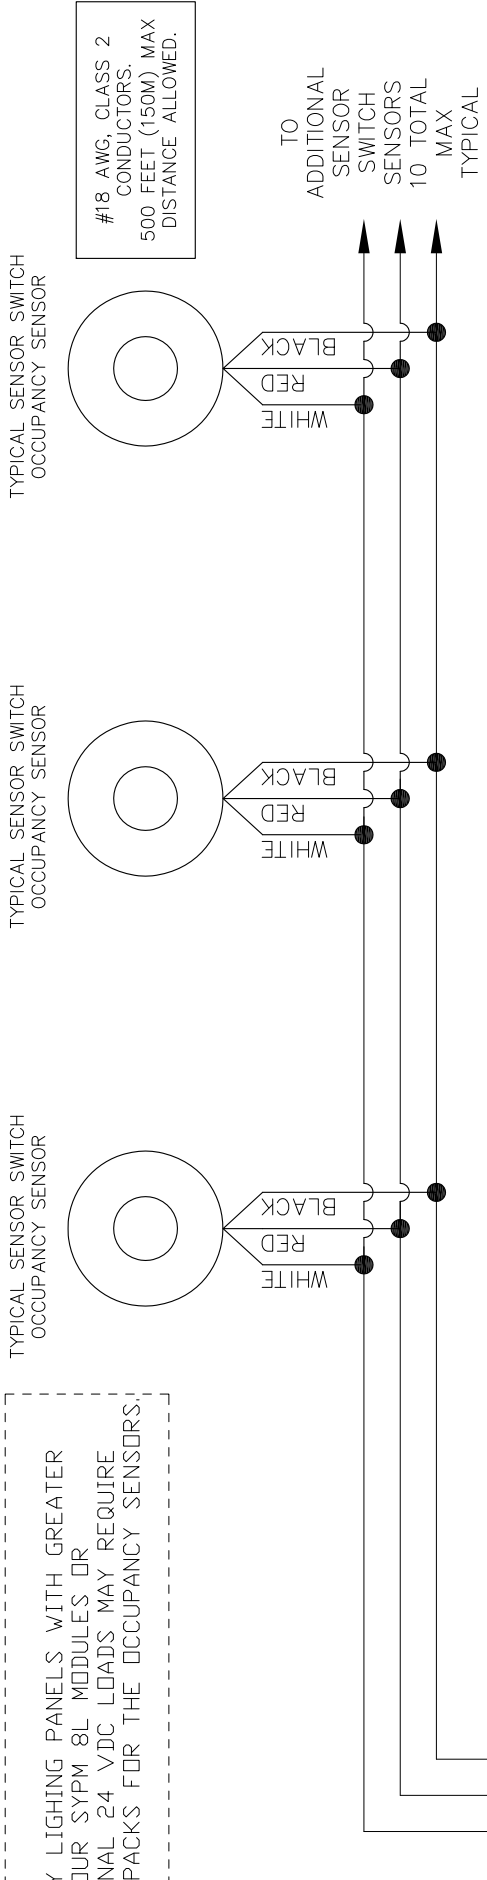



NOTE:
 SYNERGY LIGHTING PANELS WITH GREATER THAN FOUR SYPM 8L MODULES OR ADDITIONAL 24 VDC LOADS MAY REQUIRE POWER PACKS FOR THE OCCUPANCY SENSORS.



SYPM 8L POWER MODULE
 MOUNTED IN SYE ENCLOSURE

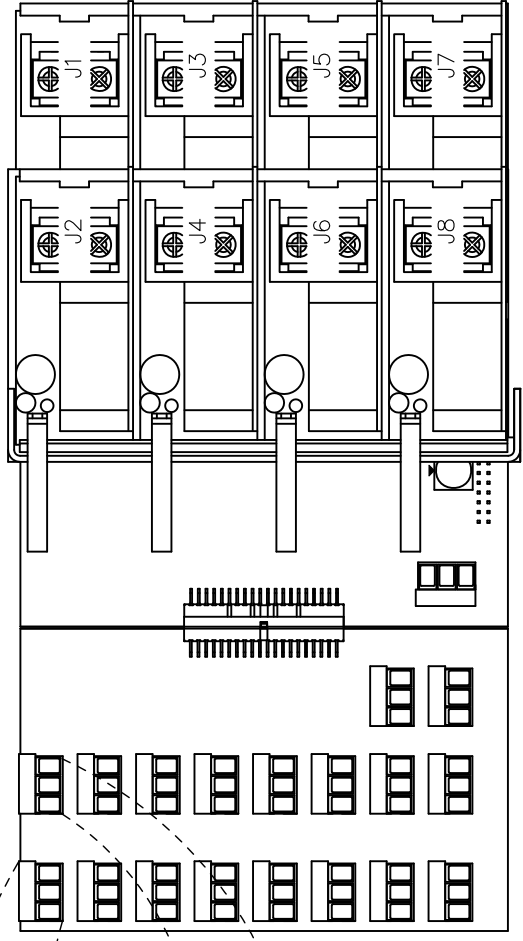

NOTE:
 ONLY ONE "-R" SENSOR IN THIS CONFIGURATION

SENSOR SWITCH OCCUPANCY SENSOR WITH AN ISOLATED RELAY "-R"

SEE EQUIPMENT INSTALLATION INSTRUCTIONS FOR WIRE SPECIFICATIONS, FEED NOTES, AND MOUNTING INSTRUCTIONS.

DESCRIPTION:
 TYPICAL WIRING DETAIL
 SENSOR SWITCH SENSOR ZONES WITH ISOLATED RELAY OPTION "-R" POWERED BY SYPM 8L

INFORMATION HEREIN CONTAINED IS THE PROPERTY OF SYNERGY LIGHTING CONTROLS SYSTEMS AND IS TO BE HELD IN COMPLETE CONFIDENCE. REPRODUCE WITH WRITTEN CONSENT ONLY.
 DATE CREATED: 11/2/2011
 PATH: O:\DRAWINGS\SYNERGY\MODULE\8L-OCC-R-M2F.DWG

Synergy
 LIGHTING CONTROLS
 An **AcuityBrands Company**
 1 LITHONIA WAY, CONYERS, GA 30012
 T: 800-533-2719 F: 770-987-1002